


# INSTALLATION INSTRUCTIONS

## FLIGHT

### HORIZONTAL FLUSH MOUNT SUPPORT

ART. NO.	225 015g	gold, horizontal
	225 015mc	matte chrome, horizontal



## IMPORTANT SAFETY INSTRUCTIONS





1. SAVE THESE INSTRUCTIONS AND REFER TO THEM WHEN ADDITIONS TO OR CHANGES IN THE TRACK CONFIGURATION ARE MADE.
2. THIS PRODUCT MUST BE INSTALLED BY A PERSON FAMILIAR WITH THE CONSTRUCTION AND OPERATION OF THE PRODUCT AND THE HAZARDS INVOLVED, IN ACCORDANCE WITH LOCAL AND NATIONAL CODE.
3. Do not install this track in Damp or Wet locations.
4. Do not install any part of the track less than 7 feet above the floor.
5. Do not install any fixture assembly closer than 6 inches from any curtain, or similar combustible material.
6. Turn off power prior to any work on the systems.
7. Do not attempt to energize anything other than lighting track fixtures specified for use with the FLIGHT system.  
To reduce the risk of fire and electric shock, do not attempt to connect power tools, extension cords, appliances, and the like to the track.
8. This track system **MUST BE HARD WIRED**. For all the wire connections, use Listed Wire Nuts.
9. Total wattage of the system must never exceed 300W or wattage supplied by the low-voltage transformer.
10. Secondary connections must be clean and tight to avoid arcing and overheating!
11. Warranty is void in case of unauthorized modifications and/ or improper use.

## READ ALL OF THESE INSTALLATION INSTRUCTIONS BEFORE INSTALLING THE SYSTEM

Contents of Delivery:  
 Flush mount support H - qty. (1)

FRONT VIEW

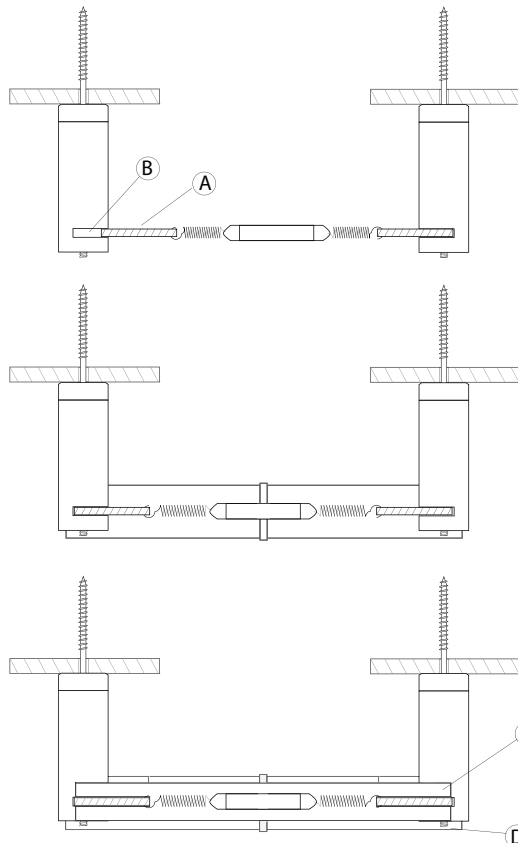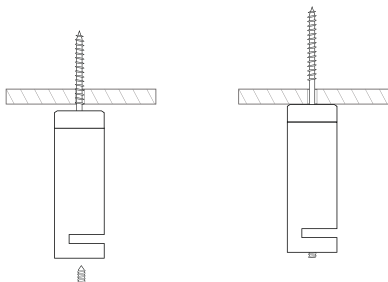

Note: Mounting positions should be marked on the ceiling or wall prior to installation.

- Mount the supports by screwing them into a firm ceiling base or wall. Align the grooves in the supports so that the track can be inserted. Supports should be placed approximately every 3 ft.

- Insert the FLIGHT track (A) into the groove of one of the mounting supports (B). Compress the track so that it will fit into the other support. It is necessary to remove the center connector (C) to allow the track to compress. Tighten the set-screw (D) firmly to secure the track.